


Detail of Reduced Pressure Backflow Prevention Assembly Inside Parallel System Installation

RPZ Shall Meet City of Kingsport, USC, and State of TN Standards. For a list of approved assemblies please contact Water Technical Services Division-(423)229-9454

Please Note that the City of Kingsport does not recommend installing RPZs inside a premises, due to potential water damage.

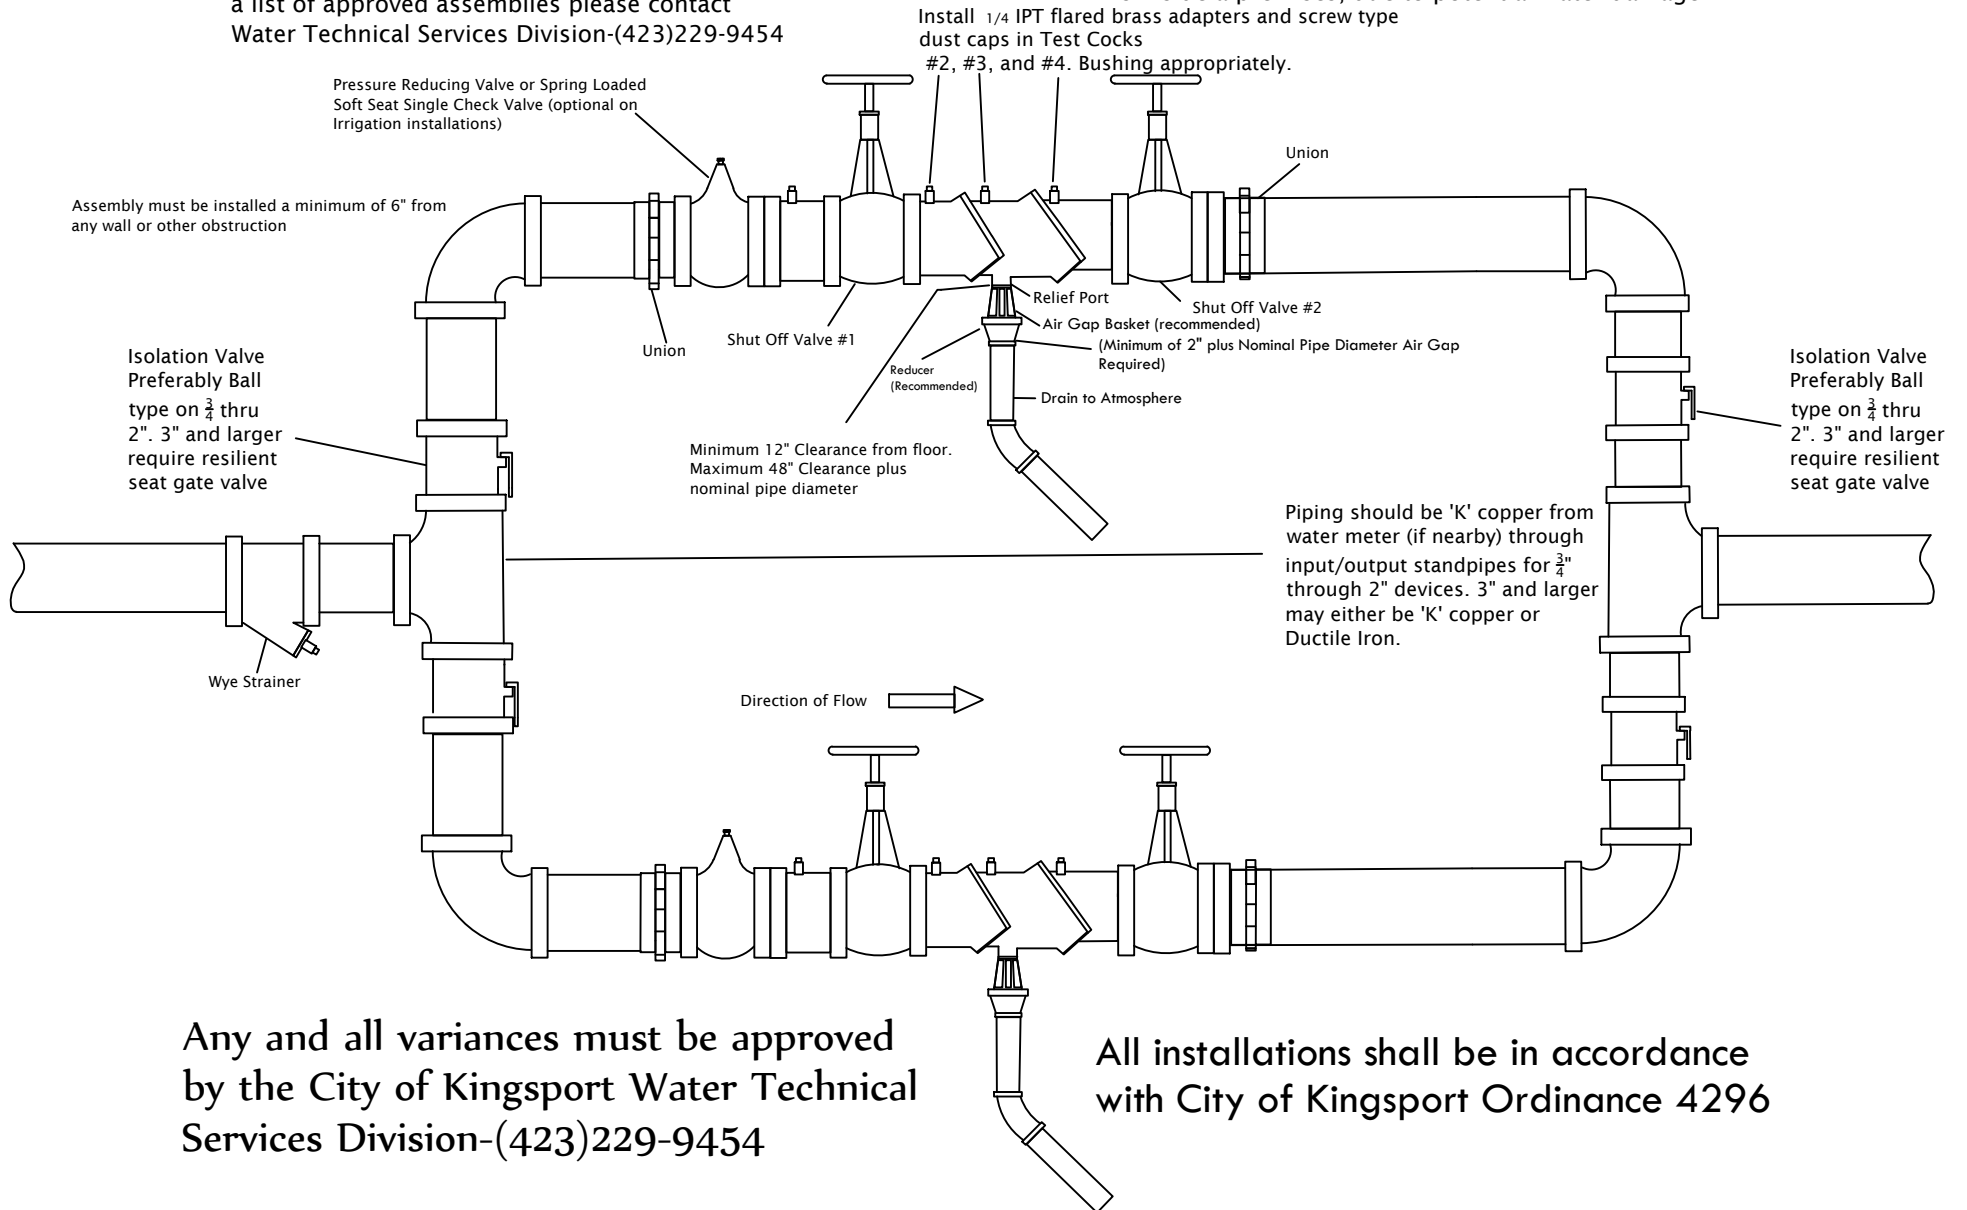

Any and all variances must be approved by the City of Kingsport Water Technical Services Division-(423)229-9454

All installations shall be in accordance with City of Kingsport Ordinance 4296