


Detail of Reduced Pressure Backflow Prevention Assembly Inside Installation

RPZ Shall Meet City of Kingsport, USC, and State of TN Standards. For a list of approved assemblies please contact Water Technical Services Division-(423)229-9454

Please Note that the City of Kingsport does not recommend installing RPZs inside a premises, due to potential water damage.

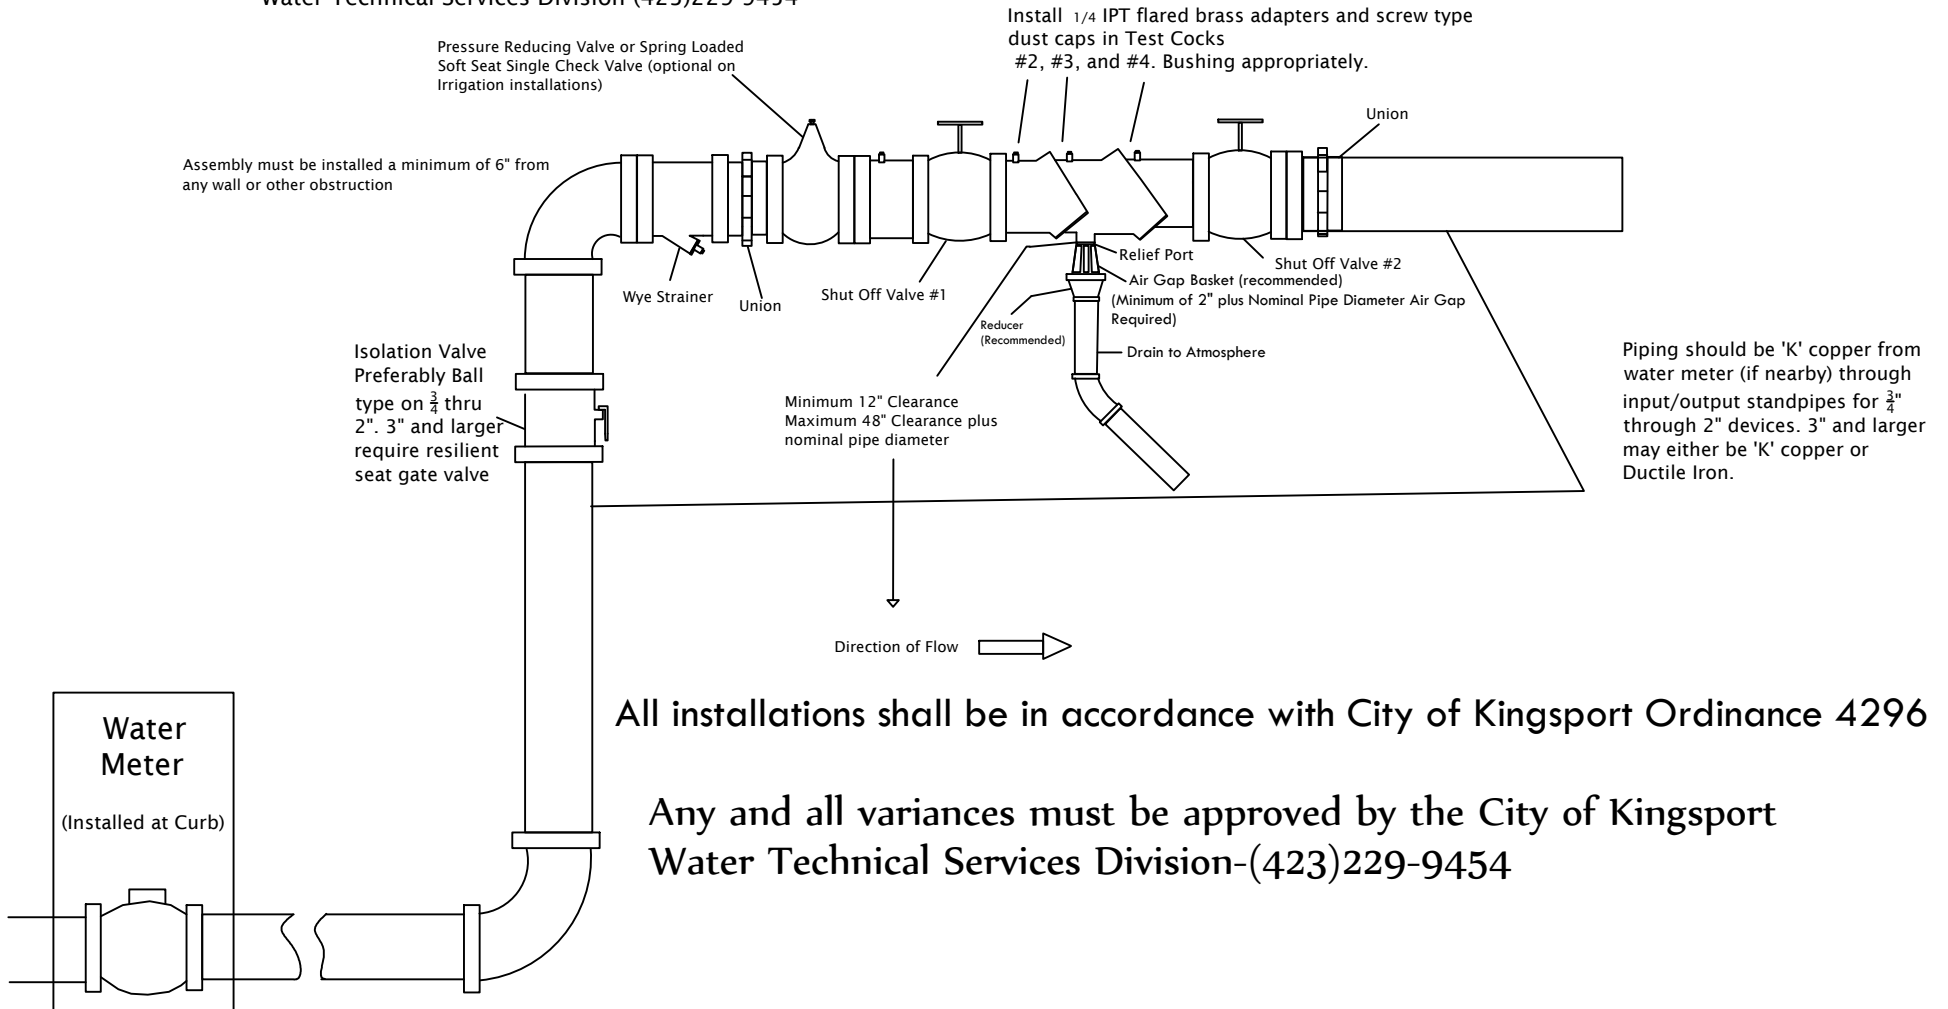

All installations shall be in accordance with City of Kingsport Ordinance 4296

Any and all variances must be approved by the City of Kingsport
Water Technical Services Division-(423)229-9454